


DRIVE - THRU

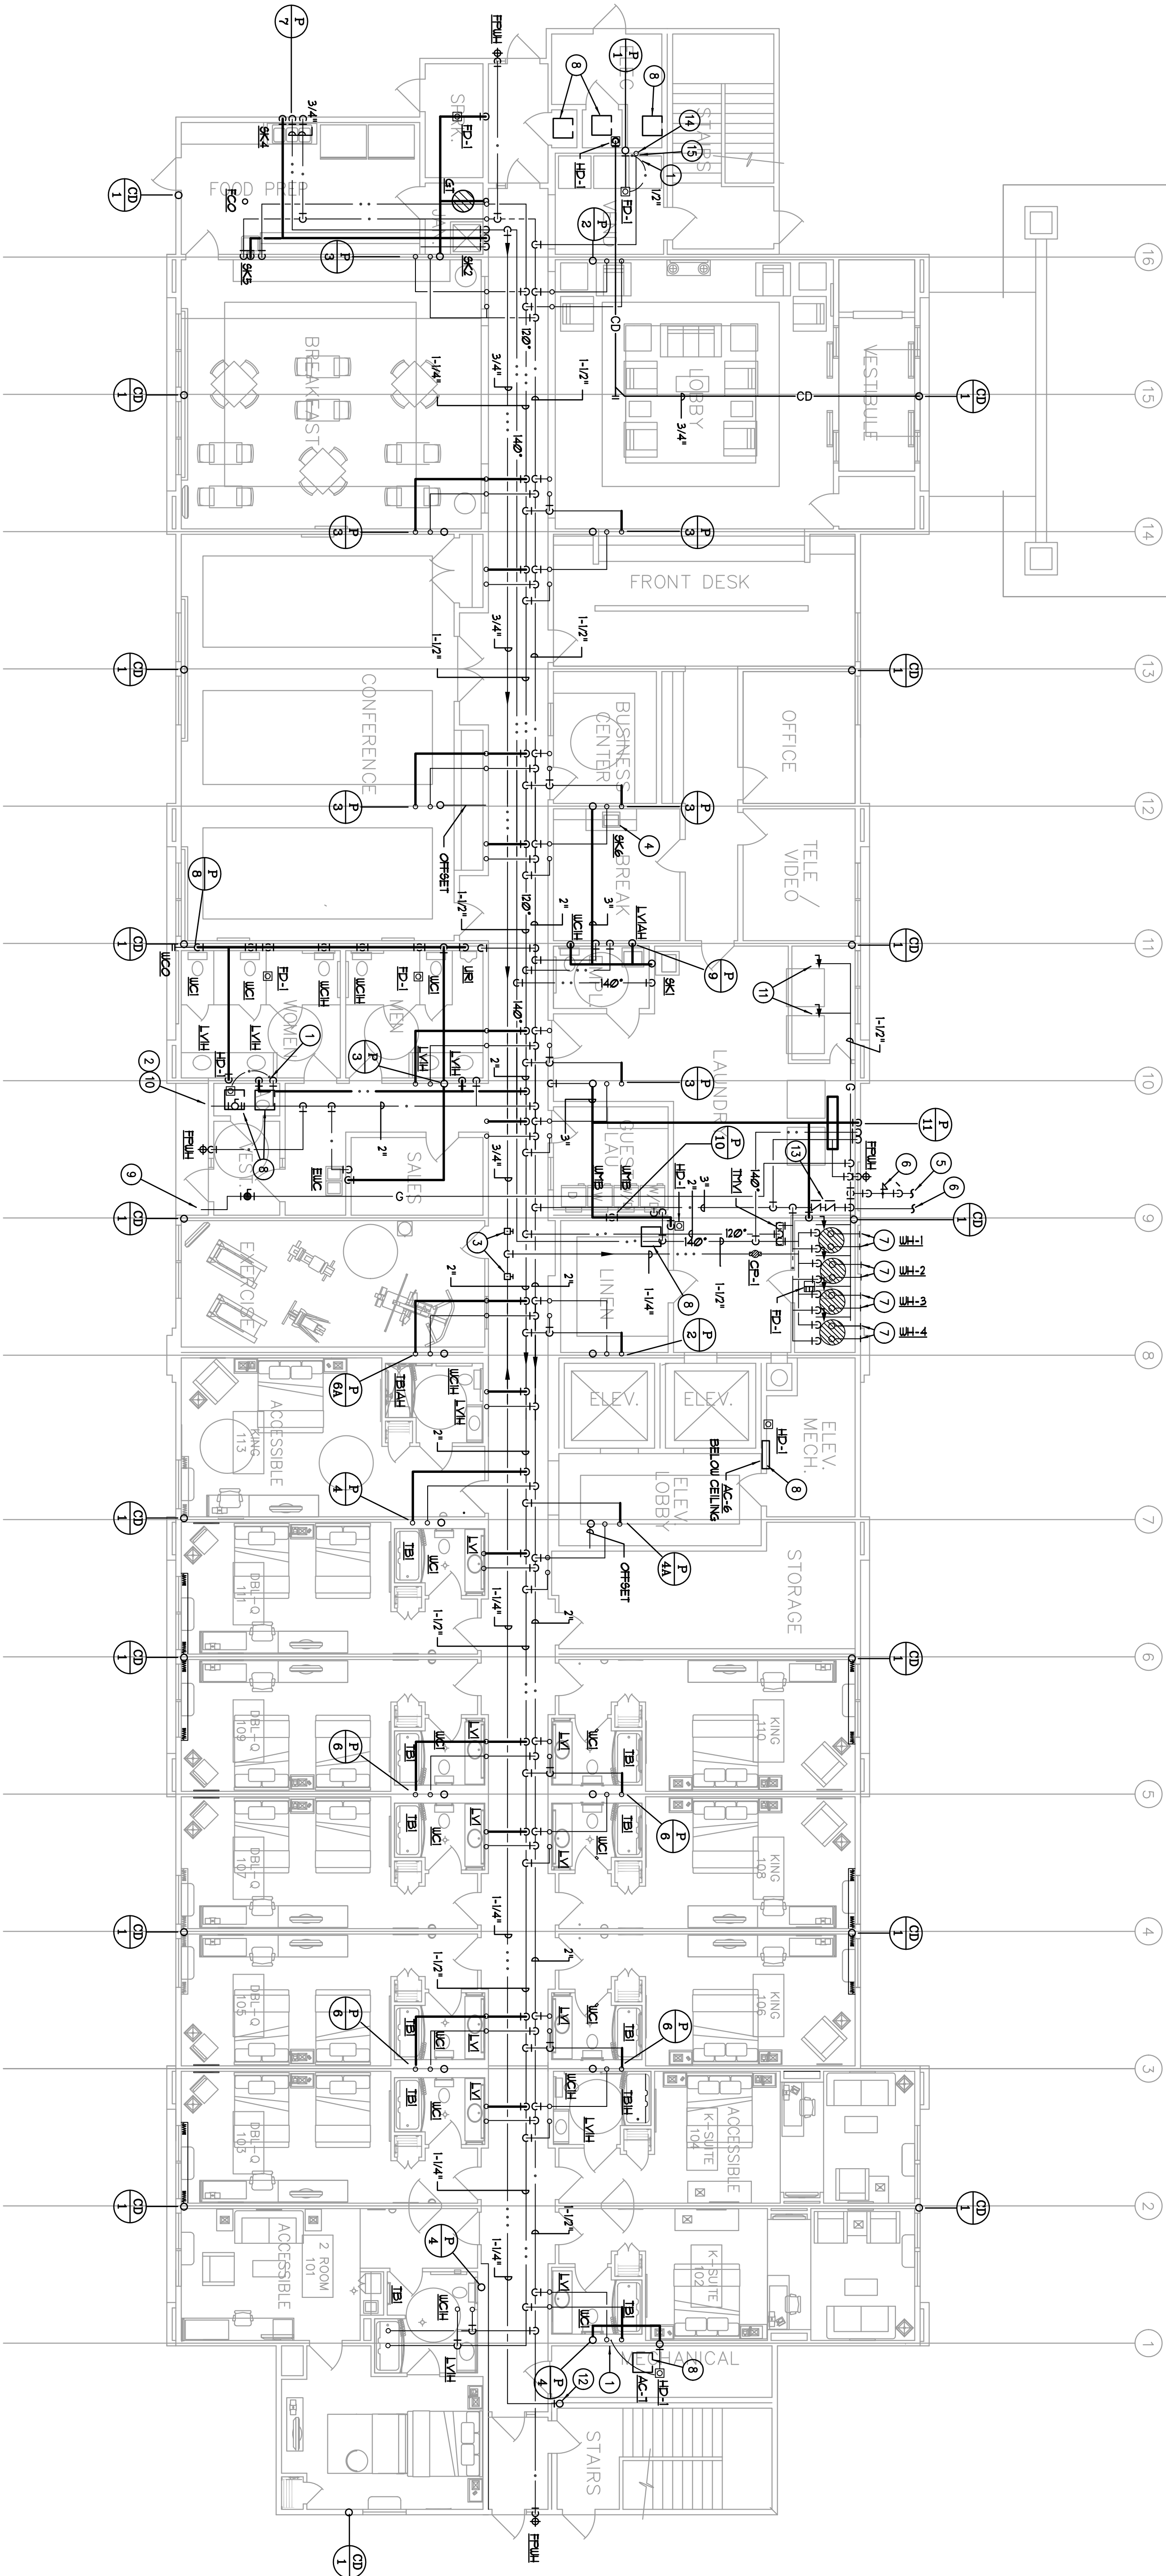

NOTES BY SYMBOL: "O"

1. FLOOR DRAIN TRAP PRIMER CONNECTION

2. 1/2" RPZ IN VERTICAL, PROVIDE DRAIN AND ACCESS FOR TESTING.

3. CIRCUIT BREAKER FOR HOT WATER RETURN

4. CONNECT 3/4" UTILITIES TO RISER P3

5. REFER TO SHEET P9 FOR CONTINUATION

6. MEDIUM TO LOW GAS PRESSURE REGULATOR

7. (1) 1/2" EXHAUST AND (1) 1/4" INTAKE FOR DIRECT AIR CONTRIBUTION PER MANUFACTURER REQUIREMENTS

8. ROUTE FILL SIZE CONDENSATE DRAIN FROM A/C UNIT TO FLOOR DRAIN

9. 1/2" DRAIN BELOW GRADE, REFER P9 FOR CONT. COORDINATE EXACT LOCATION. 600 CH

10. 1/2" COLD WATER DOWN TO BELOW FLOOR SLAB, EQUIPMENT COORDINATE EXACT LOCATION, RE: P9

11. 1/4" GAS VALVED AND CAPED FOR DRYER, 500 CH


12. 1/4" HOT WATER RETURN FROM ABOVE.
13. INSTALL BACKFLOW PREVENTER BACKFLOW PREVENTER SHALL BE EQUAL TO UNIT'S 90% 14. 1" COLD WATER UP TO ICE MACHINE ABOVE THE OFF AT EACH FLOOR WITH A VALVED 3/4" CONNECTION IN A RECESSED WALL BOX

15. DROP 3/4" COLD WATER WITH VALVED CONNECTION IN RECESSED WALL BOX FOR ICE MACHINE CONNECTION

1 FIRST FLOOR PLAN-PLUMBING

SCALE: 1/8" = 1'-0"

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY JAMES SINKER HARVEY P.E. #41297 ON MAY 24, 2010 FOR THE PURPOSES OF REVIEW, PREPARING & SEALING THIS DOCUMENT. ANY REUSE OF THIS SEAL OR SEALING WITHOUT THE WRITTEN CONSENT OF THE ABOVE ENGINEER IS AN OFFENSE TO THE TEXAS STATE BOARD RULES.

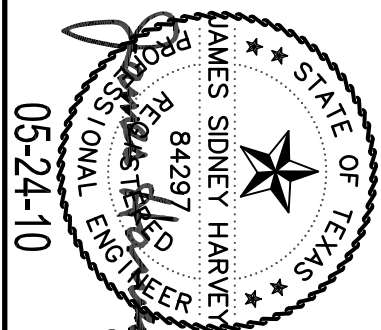

ARK Engineer and Consultants Inc. (FIRM #4127)
2604 Westerland Drive, #309, Houston, Texas 77063
Ph. 832.236.7165, Fax. 832.218.9181
e-mail address: jharvey@arkengineer.com

R S S ARCHITECTS L.L.C.	
2201 DOTTIE LYNN PKWY. SUITE 145 FORT WORTH, TEXAS 76120	
PH: 817/640-9003	FAX: 817/649-8410
Drawn	08060
Reviewed	02-17-10
Date	
Job	
Sheet	P2
Of	Sheets



LaQuinta Inn and Suites
MARKET CENTER - LOCATION 6482
DALLAS, TEXAS

REVISIONS	BY