

REVISIONS	BY



LaQuinta Inn and Suites  
MARKET CENTER – LOCATION 6482  
DALLAS, TEXAS


RSS ARCHITECTS L.L.C.  
2201 DOTTIE LYNN PKWY, SUITE H5  
FORT WORTH, TEXAS 76120  
P/E: 817/640-9003 FAX: 817/649-8440

Date	02-17-10
Reviewed	
Drawn	
Job	08060
Sheet	
Of	M3 Sheets

THE SEAL APPEARING ON THIS DOCUMENT WAS SUBMITTED BY JAMES SIDNEY HARVEY  
P/E #0497 ON MAY 24, 2010 FOR THE PURPOSE OF SEALING & REISSUING &  
& REVIEW ONLY. ATTENTION OF A SEALED DOCUMENT WITHOUT PROPER NOTIFICATION  
TO THE ABOVE ENGINEER IS AN OFFENSE TO THE TEXAS STATE BOARD RULES.



ARK Engineer and Consultants Inc. (FIRM #4127)  
2604 Westerland Drive, #309, Houston, Texas 77063  
Ph.832.236.7165, Fax.832.218.9181  
e-mail address: jharvey@arkengineer.com

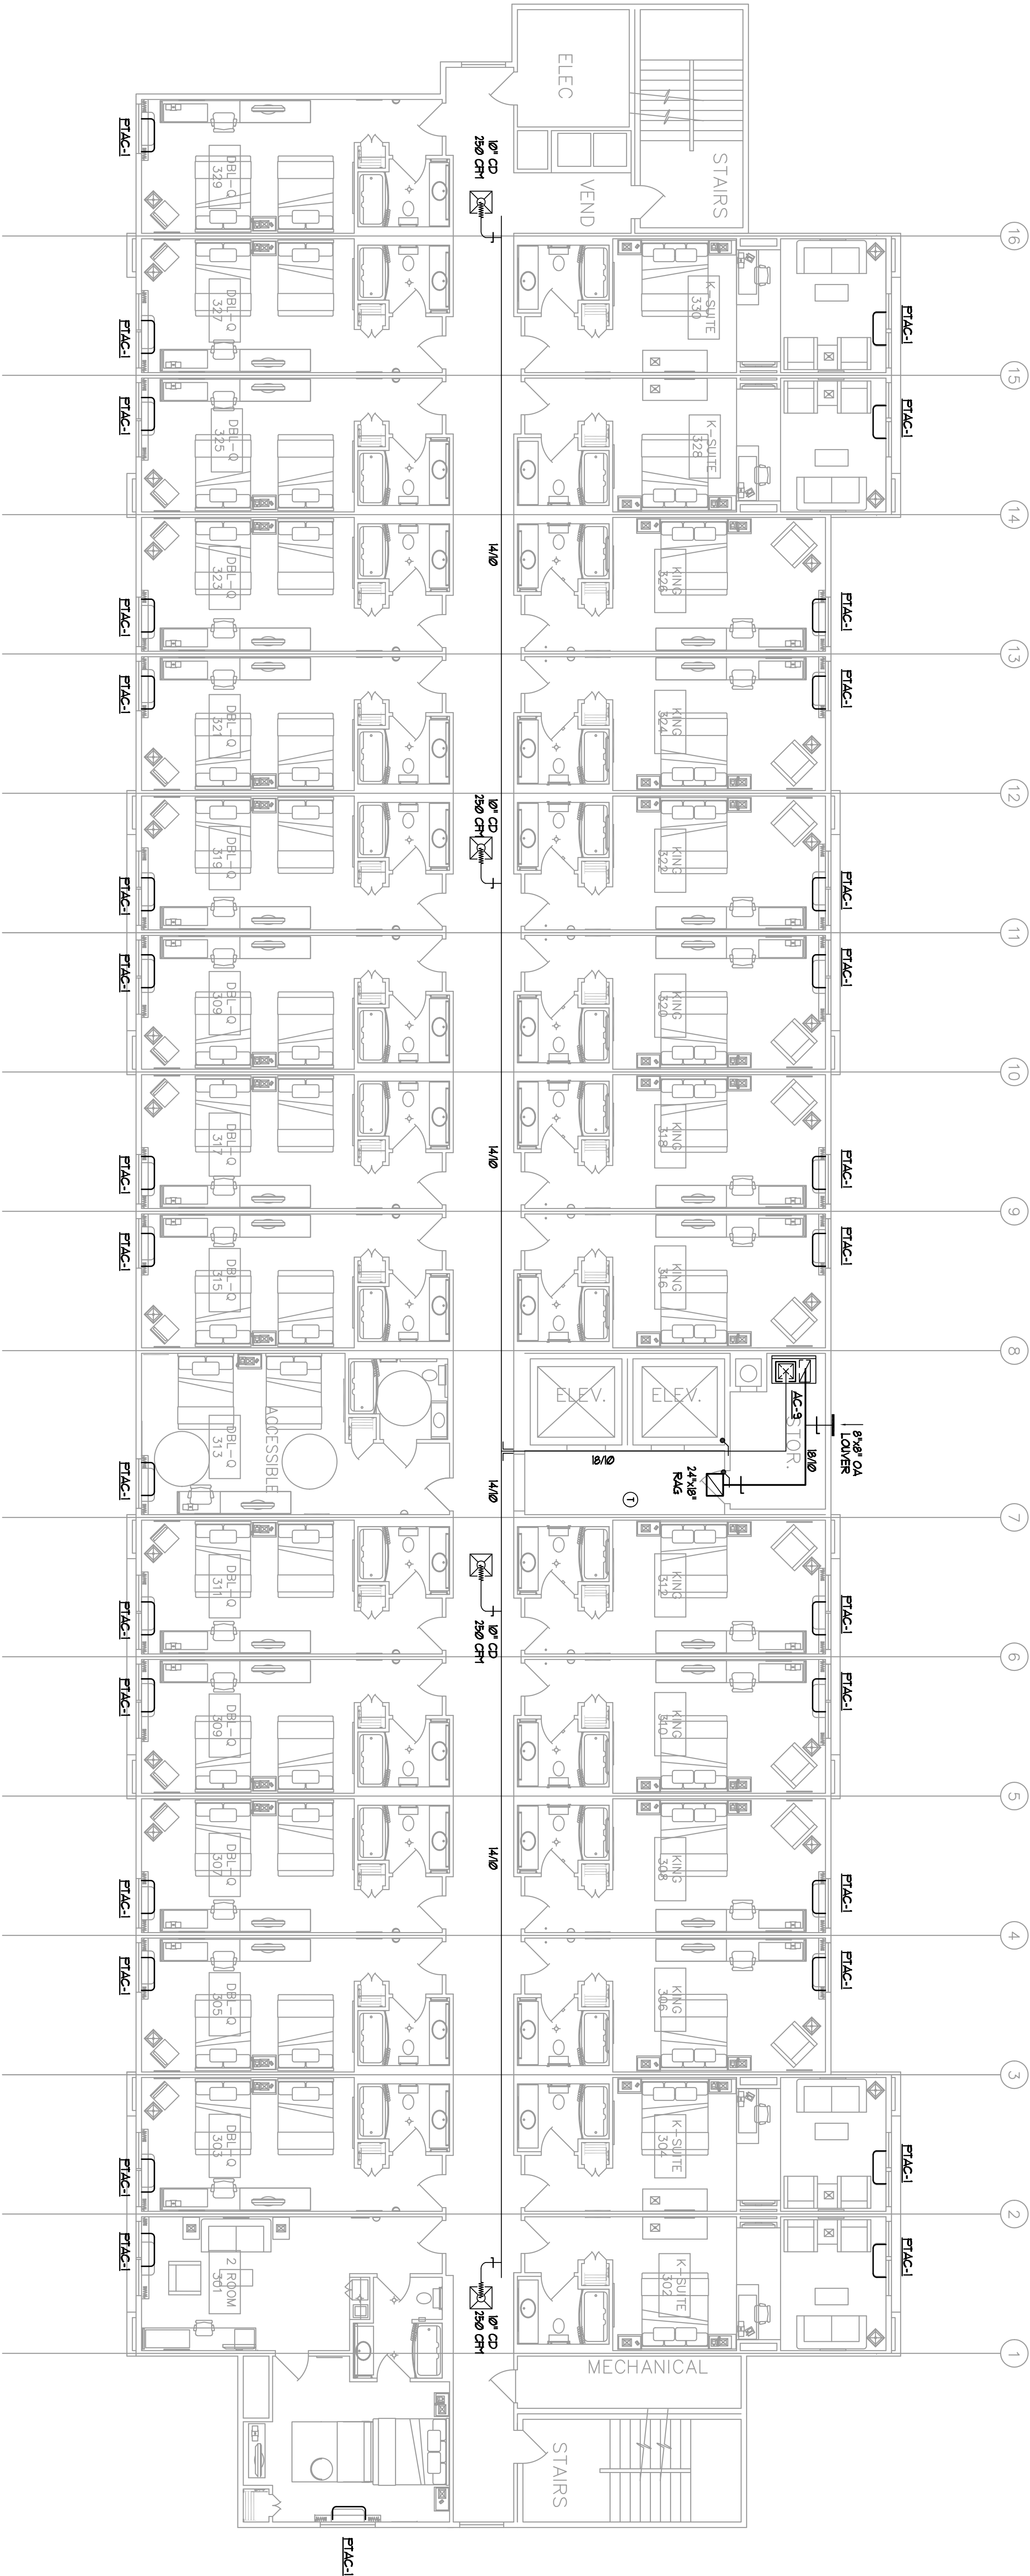

1 THIRD FLOOR PLAN-HVAC  
SCALE: 1/8" = 1'-0"

#### GENERAL NOTES :

1. LOCATE OUTSIDE AIR INTAKES MINIMUM 8'-0" FROM VENTS, EXHAUSTS & FILES.
2. CONDENSATE AC UNIT LOCATIONS, AIR DEVICE LOCATIONS AND DUCT ROUTING WITH STRUCTURAL MEMBERS AND ADJUST ACCORDINGLY.
3. PROVIDE ALL CONDENSING UNITS WITH CONCRETE PADS.
4. PROVIDE 3/4" CONDENSATE DRAIN FROM ALL COOLING COILS. DRAIN TO NEAREST FLOOR DRAIN. FLOODS ON FIRST FLOOR SHALL DRAIN TO DRY WELLS.
5. PROVIDE FIRE DAMPER SMOKE DAMPERS, & FIRE-SMOKE DAMPERS AS REQUIRED BY THE AUTHORITIES HAVING JURISDICTION.
6. SIZE AND INSTALL REFRIGERANT PIPING PER MANUFACTURERS RECOMMENDATIONS.
1. PROVIDE CORRELATION AIR TO ALL GAS APPLIANCES PER CODE REQUIREMENTS.
8. CONSTRUCT RA FLEATHS BELOW 96" LIT INDOOR UNITS SUCH THAT FLOOR DRAINS ARE ACCESSIBLE PER CODE REQUIREMENTS.

#### KEYED NOTES :

1. 14"x18" RA DUCT DOWN TO FLEATH BELOW AC UNIT.
2. OA DUCT DOWN TO RA DUCT OR FLEATH WITH DAMPER.
3. (7) R46 WITH TRAP-LESS DUCT, SIZE OF GRILLES AND DUCT AS INDICATED.