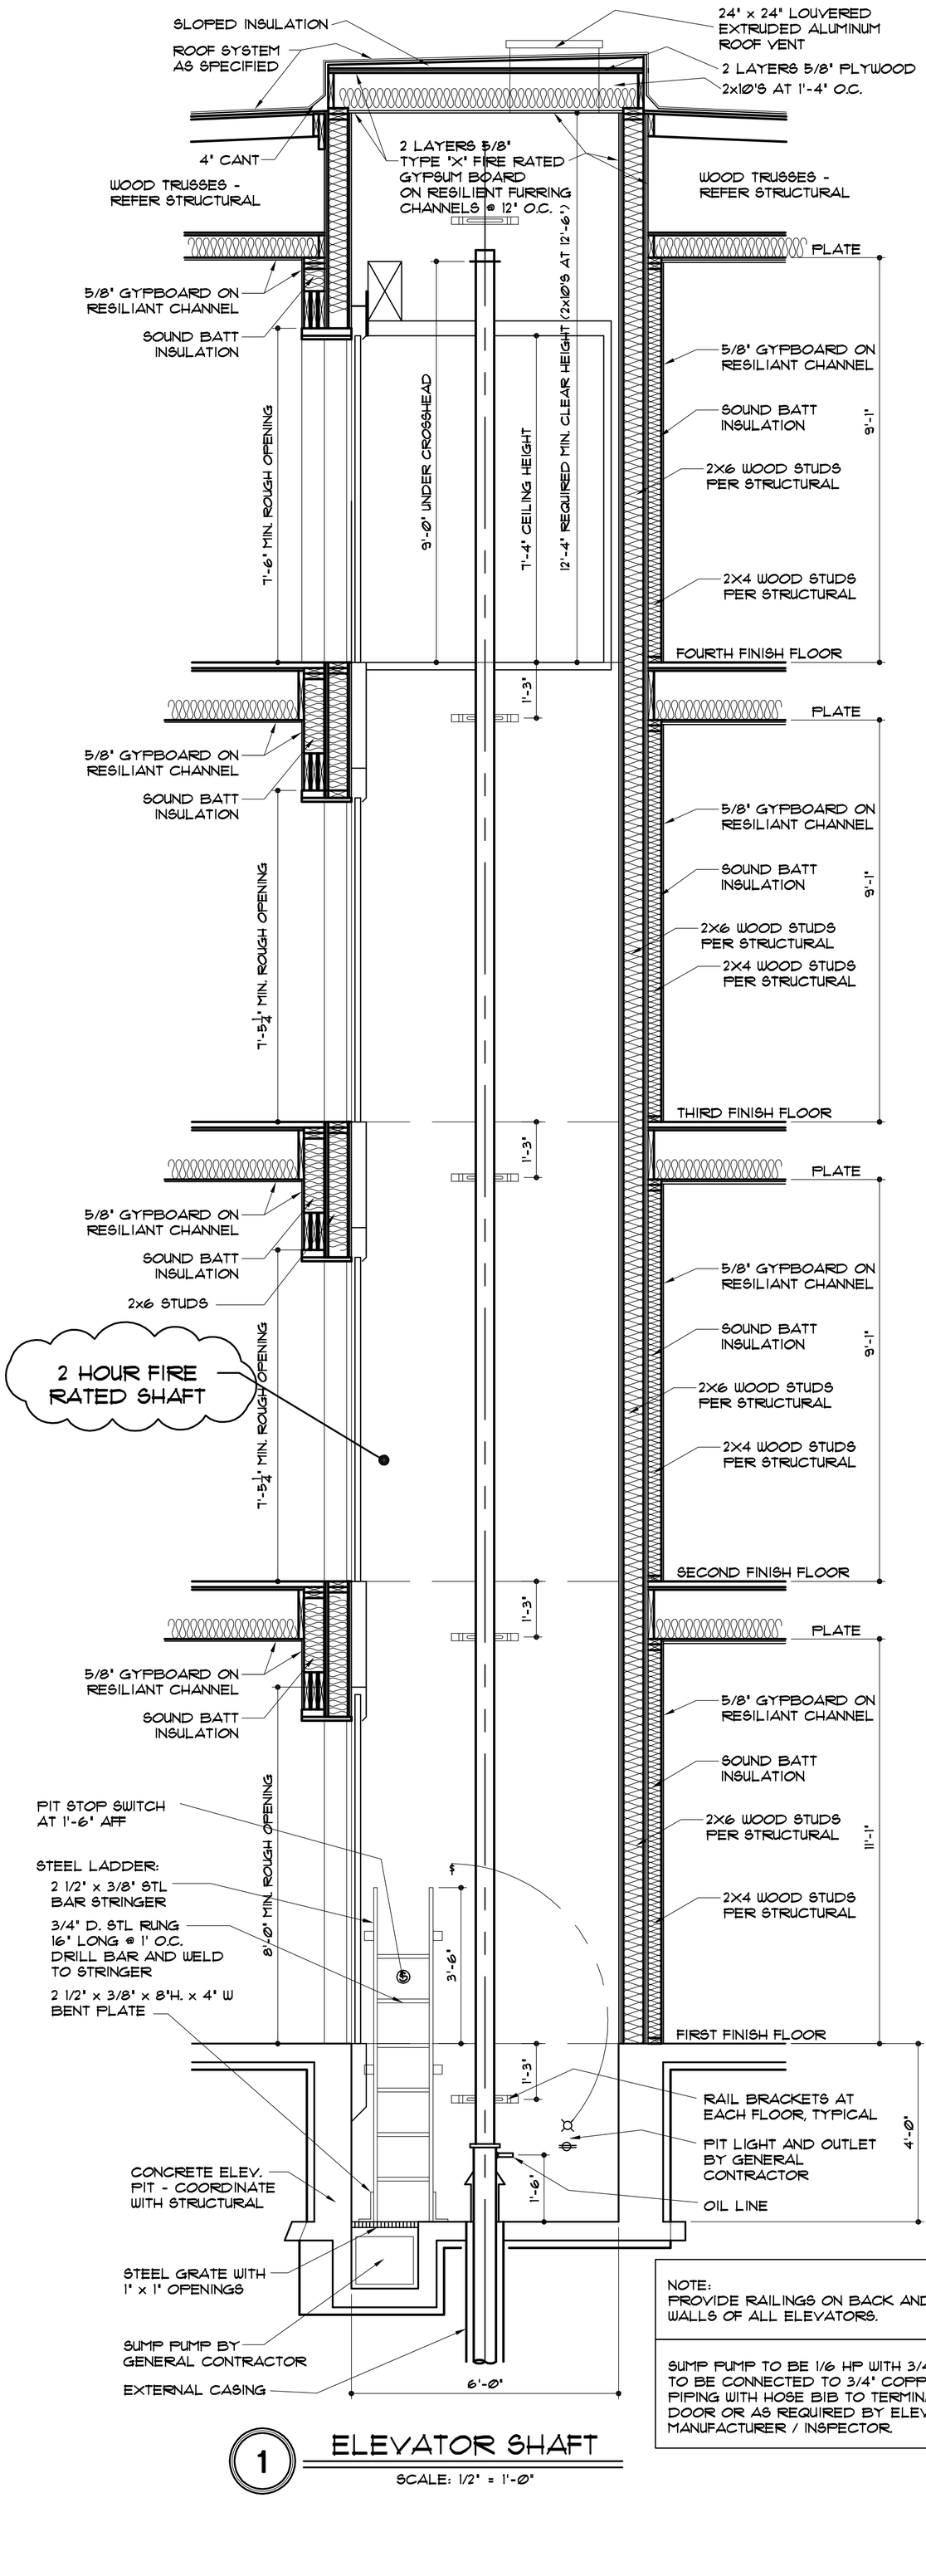

NOTE:
PROVIDE RAILINGS ON BACK AND SIDE WALLS OF ALL ELEVATORS.

SUMP PUMP TO BE 1/6 HP WITH 3/4" DISCHARGE TO BE CONNECTED TO 3/4" COPPER PIPING WITH HOSE BIB TO TERMINATE AT DOOR OR AS REQUIRED BY ELEVATOR MANUFACTURER / INSPECTOR.

1 ELEVATOR SHAFT

SCALE: 1/2" = 1'-0"

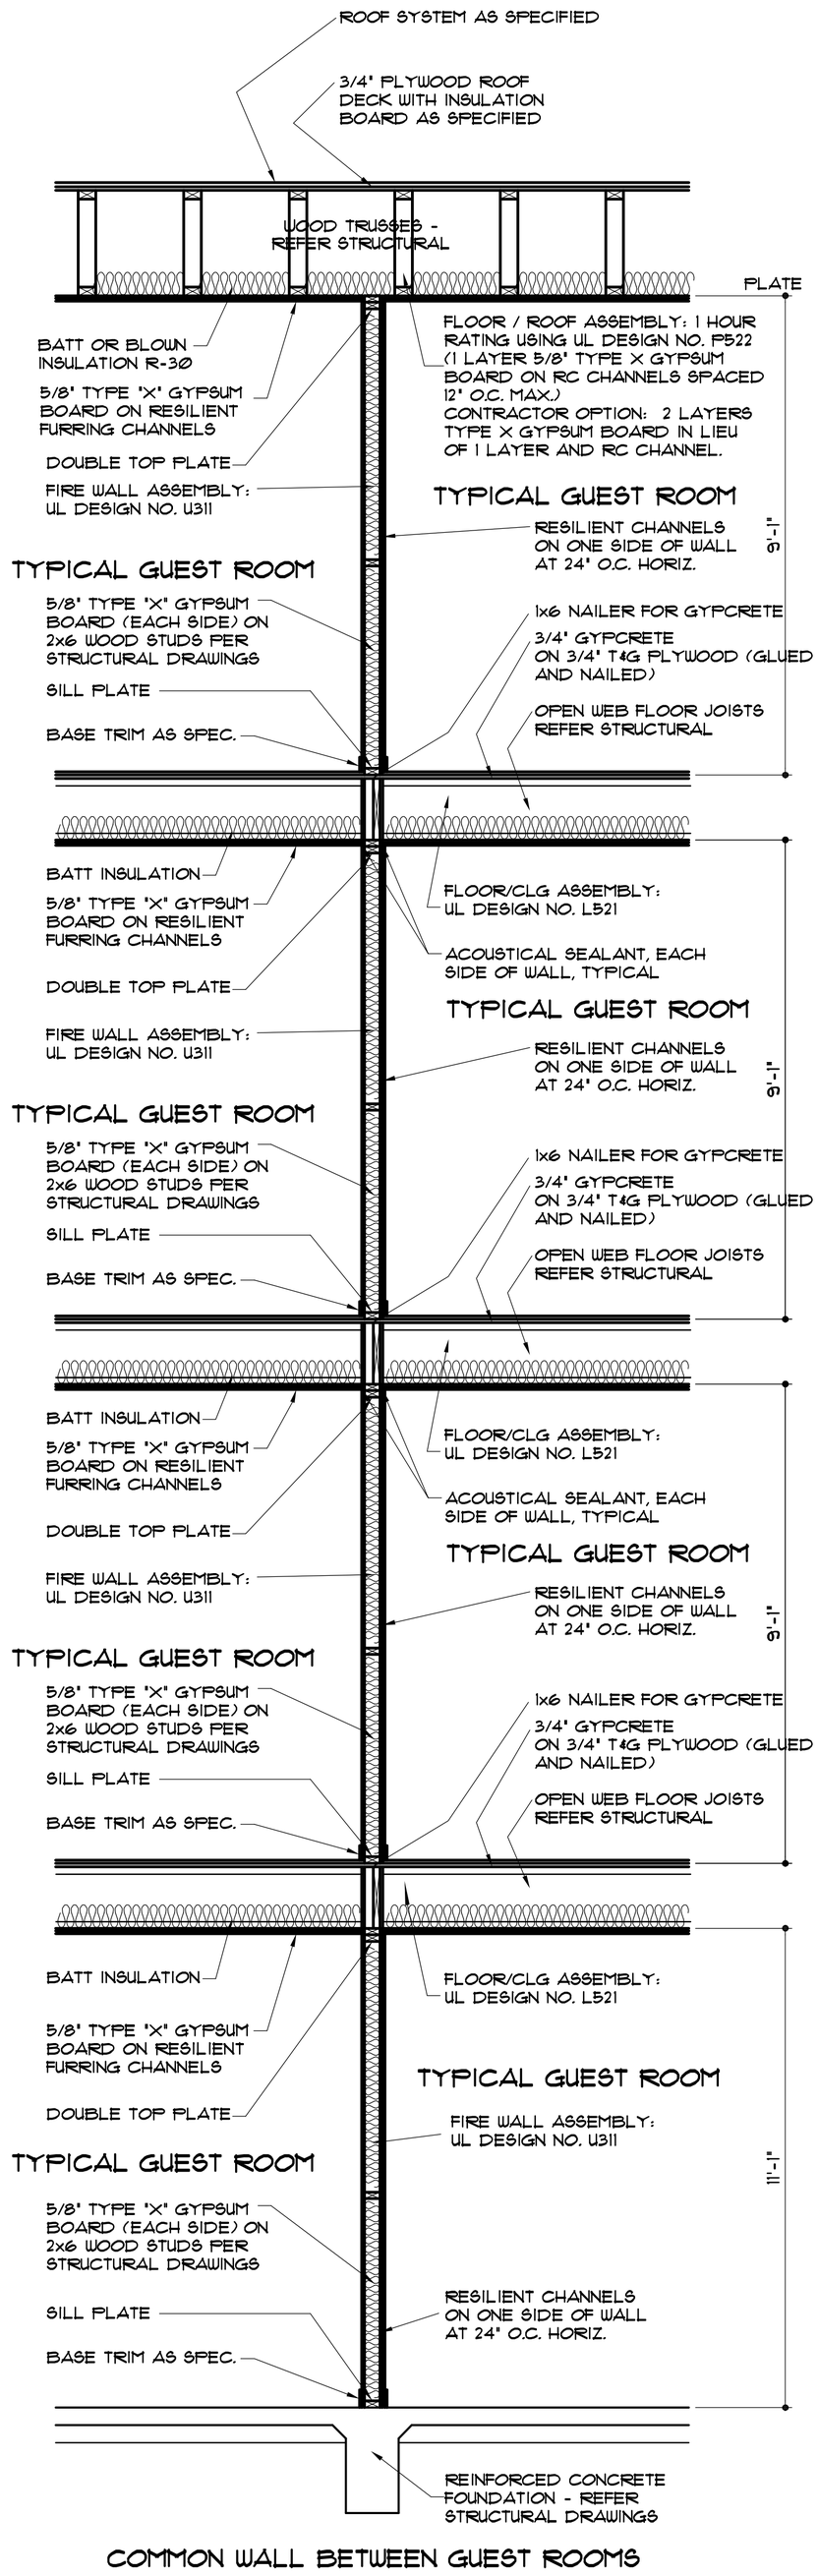

COMMON WALL BETWEEN GUEST ROOMS

2 INTERIOR WALL SECTION

SCALE: 1/2" = 1'-0"

R S S ARCHITECTS L.L.C.
2201 DOTTIE LYNN PKWY. SUITE 145
FORT WORTH, TEXAS 76120
PH: 817/640-9003 FAX: 817/649-8410

LaQuinta Inn and Suites

MARKET CENTER - LOCATION 6482
DALLAS, TEXAS

Sheet A-309 Of Sheets
Job 080660
Drawn
Reviewed
Date 2-17-10

REVISIONS BY