




GENERAL NOTES:

- REFER TO SHEET'S E2 & E3 FOR APPLICABLE GENERAL NOTES.
- PROVIDE SMOKE DETECTORS AND AUDIOVISUAL DEVICES IN EACH ROOM AS REQUIRED PER ADA, NFPA & AHJ.
- FIRE ALARM SYMBOLS SUCH AS "F", "H", "AV" ETC. AS SHOWN ON PLAN ARE DIAGNOSTIC ONLY. EXACT QUANTITY AND LOCATION SHALL BE DETERMINED BY THE ALARM DESIGNER/CONTRACTOR ON THIS PROJECT AND ALL THE SYMBOL "AV" INDICATES AUDIOVISUALS ARE DETECTOR INSIDE THE BEDROOM PER ILL. CONTRACTOR SHALL MAKE SURE THAT ALL THE GUEST ROOMS AS SHOWN ON THE OVERALL FLOOR PLANS ARE ACCOUNTED FOR AND LISTED ON THIS SHEET FOR PRIOR TO BID. NOTIFY THE ARCHITECT/ENGINEER WHEN THERE IS ANY DISCREPANCY.
- CONTRACTOR SHALL BE RESPONSIBLE TO PAY FOR ALL EXPENSES TO COMPLETE THE ELECTRICAL FOR ALL GUEST ROOMS REGARDLESS THEY ARE LISTED ON THIS SHEET. IN CASE ANY GUEST ROOM NUMBER(S) ARE NOT LISTED OR REFERENCED ON THIS SHEET, ELECTRICAL SHALL BE PROVIDED AT THE CONTRACTOR'S EXPENSES.
- LIGHT SWITCHES, TV, CONTROLS SHALL BE MTD. AT 44" AFF. & RECEPTACLE OUTLET SHALL BE MTD. AT NO MORE THAN 5' AFF. AT THE ACCESSIBLE GUESTROOMS IN ADDITION PROVIDE ROCKER SWITCHES ON A SLEVE IN LIGHT FIXTURES UNLESS OTHERWISE NOTED.
- F. PROVIDE ADDITIONAL AUDIOVISUAL, ALARM DEVICES IN HEARING COMMUNICATIONS/ELECTRONICS SYSTEM AND ADDITIONAL STROBE LIGHT SMOKE ALARMS IN ADDITIONAL TO TYPICAL AUDIBLE SMOKE ALARMS AT THE ACCESSIBLE GUESTROOMS PER OWNER'S REQUIREMENTS. COORDINATE AND VERIFY EXACT REQUIREMENTS WITH OWNER.
- PROVIDE A WALL SWITCH FOR NIGHT LIGHT IMMEDIATELY ADJACENT TO ENTRANCE OF BATHROOM. WALL SWITCH SHALL BE UN-020 NOTION SENSOR NIGHTLIGHT BY WAIT STOFFER OR APPROVED EQUAL. THE LED LIGHT SHALL BE WHITE.

NOTES BY SYMBOL: " " " " " "


- PROVIDE 30A/40P DISCONNECT SWITCH & SPECIAL OUTLET FOR 208V, 1-PHASE HVAC UNIT. REFER TO MECHANICAL DRAWING FOR EXACT TYPE AND LOCATION OF PTAC.
- PROVIDE 120V, 20A CIRCUIT FOR BATHROOM GFI OUTLET ABOVE COUNTER.
- PROVIDE QUADRAPLEX OUTLET AND TV OUTLET AT BY AFF.
- PROVIDE DUPLEX OUTLET AND TV OUTLET AT BY AFF.
- RECEPTACLE OUTLET AS INDICATED SHALL BE HALF SWITCHED.
- PREPARED ROOM PER ADA, NFPA & AHJ.
- PROVIDE OUTLET FOR MICROWAVE ON DEDICATED CIRCUIT. OTHER APPLIANCE COUNTER OUTLETS SHALL BE ON OTHER APPLIANCE CIRCUIT.
- PROVIDE J-BOX FOR THERMOSTAT WITH FILL WIRE N 3/4" TO ABOVE CEILING. PROVIDE OUTLET WITH FLOOR LOCATIONS AS NOTED AT THE ACCESSIBLE GUESTROOMS.
- PROVIDE UL LISTED SWITCH TO SWITCH OFF RECEPTABLES WITH NOTE BY SYMBOL "4" DEVOTED AND SWITCHING ASSIGNMENT AS INDICATED.
- MTD. HORIZONTALLY AT NIGHTSTANDS.
- ILLUMINATED LIGHT SWITCH AT ENTRY AND BATHROOM TYPICAL.

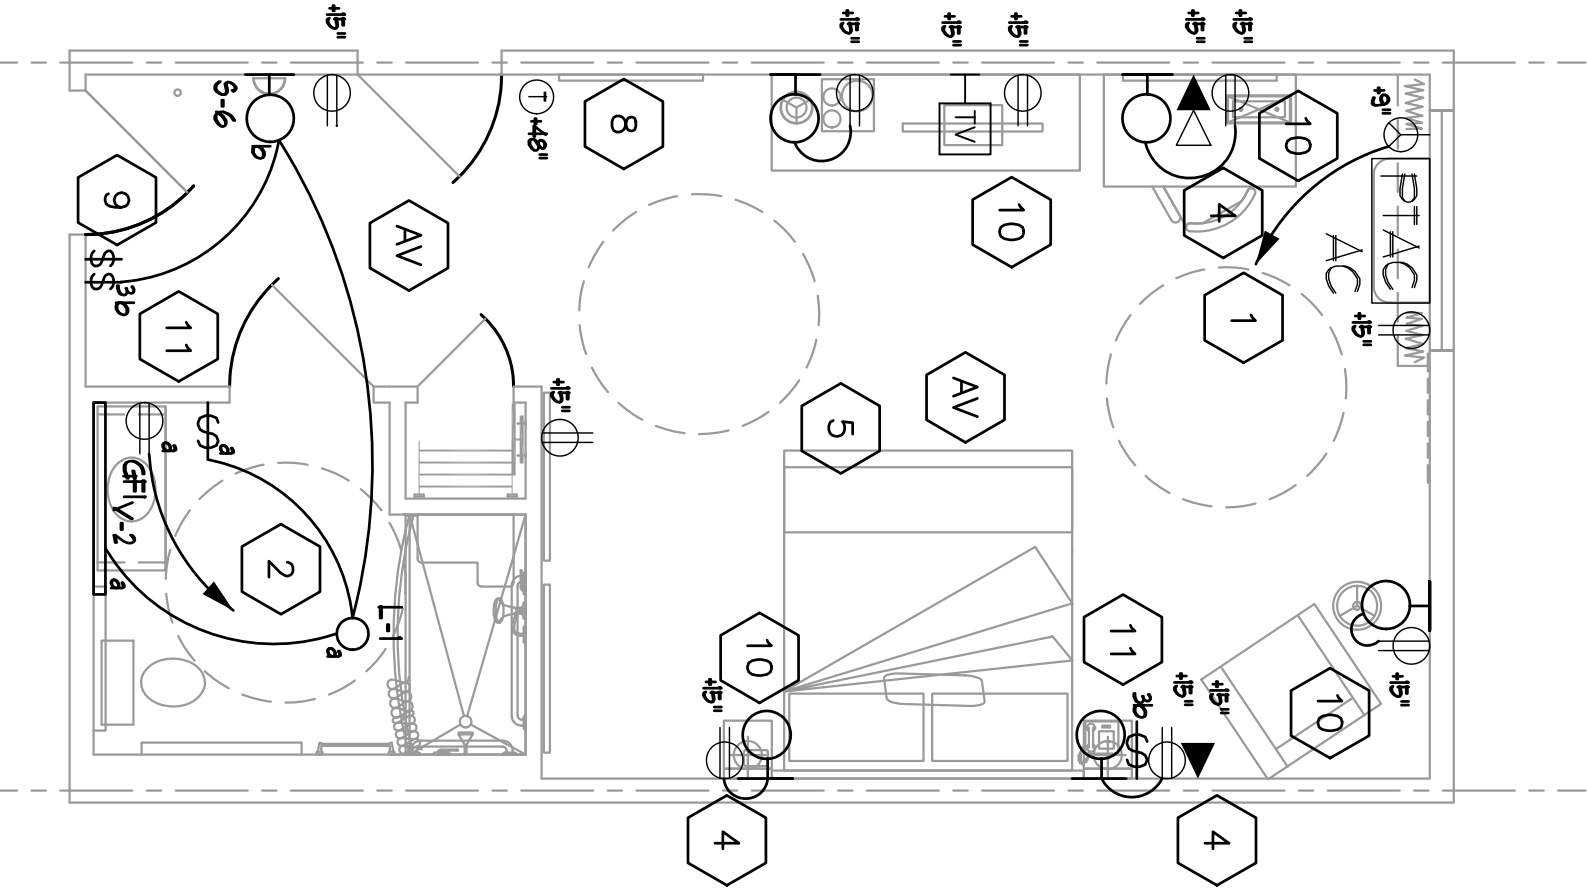

KING ROOM ACCESS.

SCALE: 1/4" = 1'-0"


SIMILAR FOR ROOMS 1B3.  
CONNECT WITH NO MORE THAN 5 RECEPTACLE OUTLETS PER EACH 20A CIRCUIT.

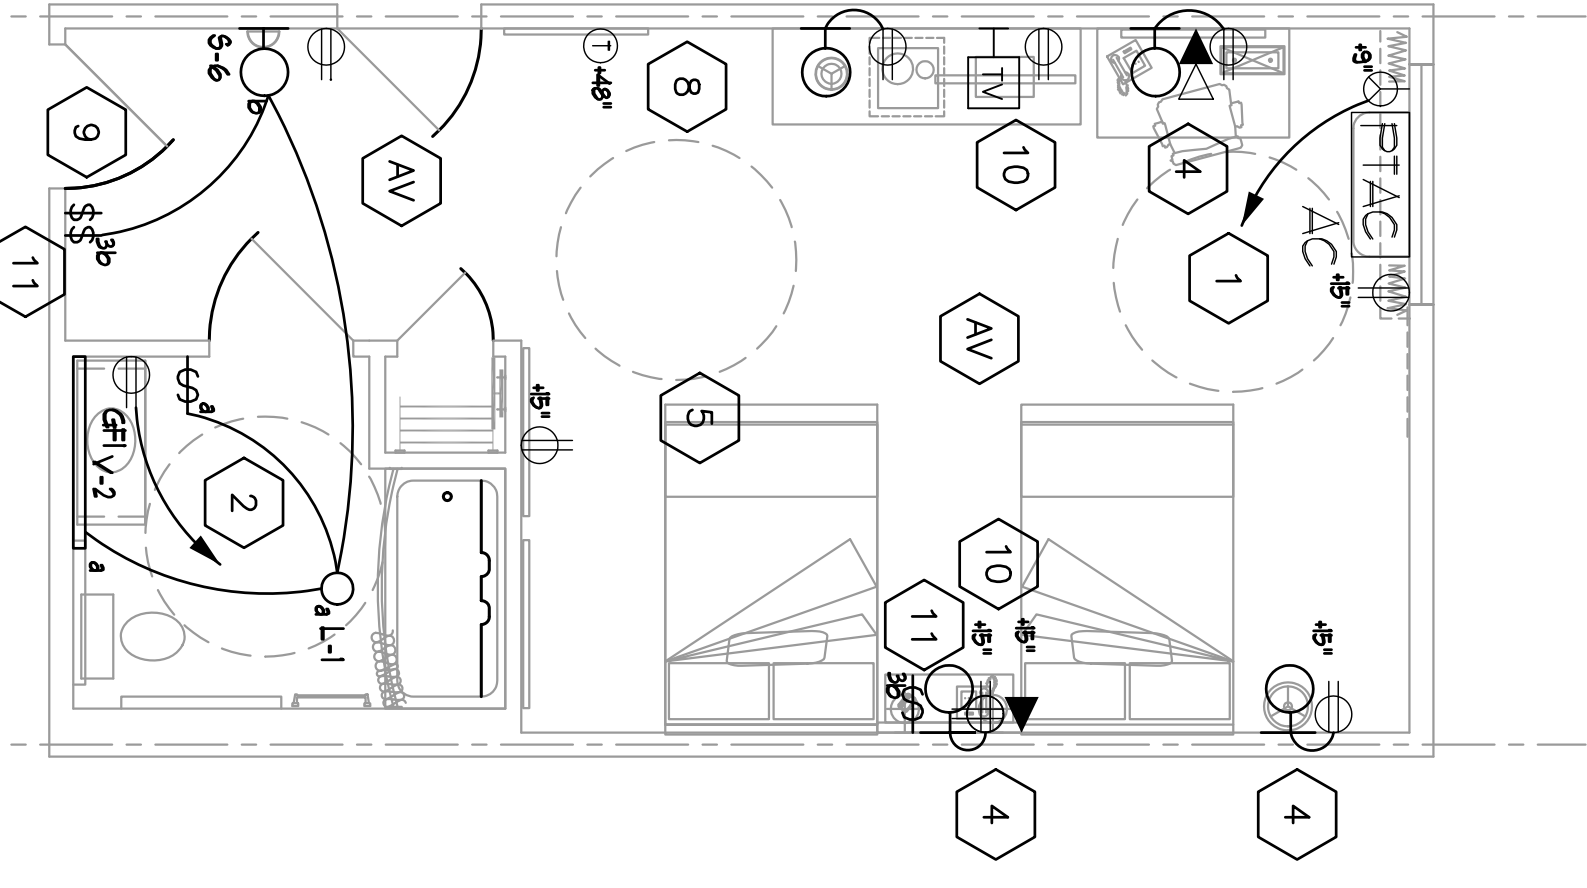

DOUBLE QUEEN RM ACCESS.

SCALE: 1/4" = 1'-0"


SIMILAR FOR ROOMS 2B3, 3B3, 4B3.  
CONNECT WITH NO MORE THAN 5 RECEPTACLE OUTLETS PER EACH 20A CIRCUIT.

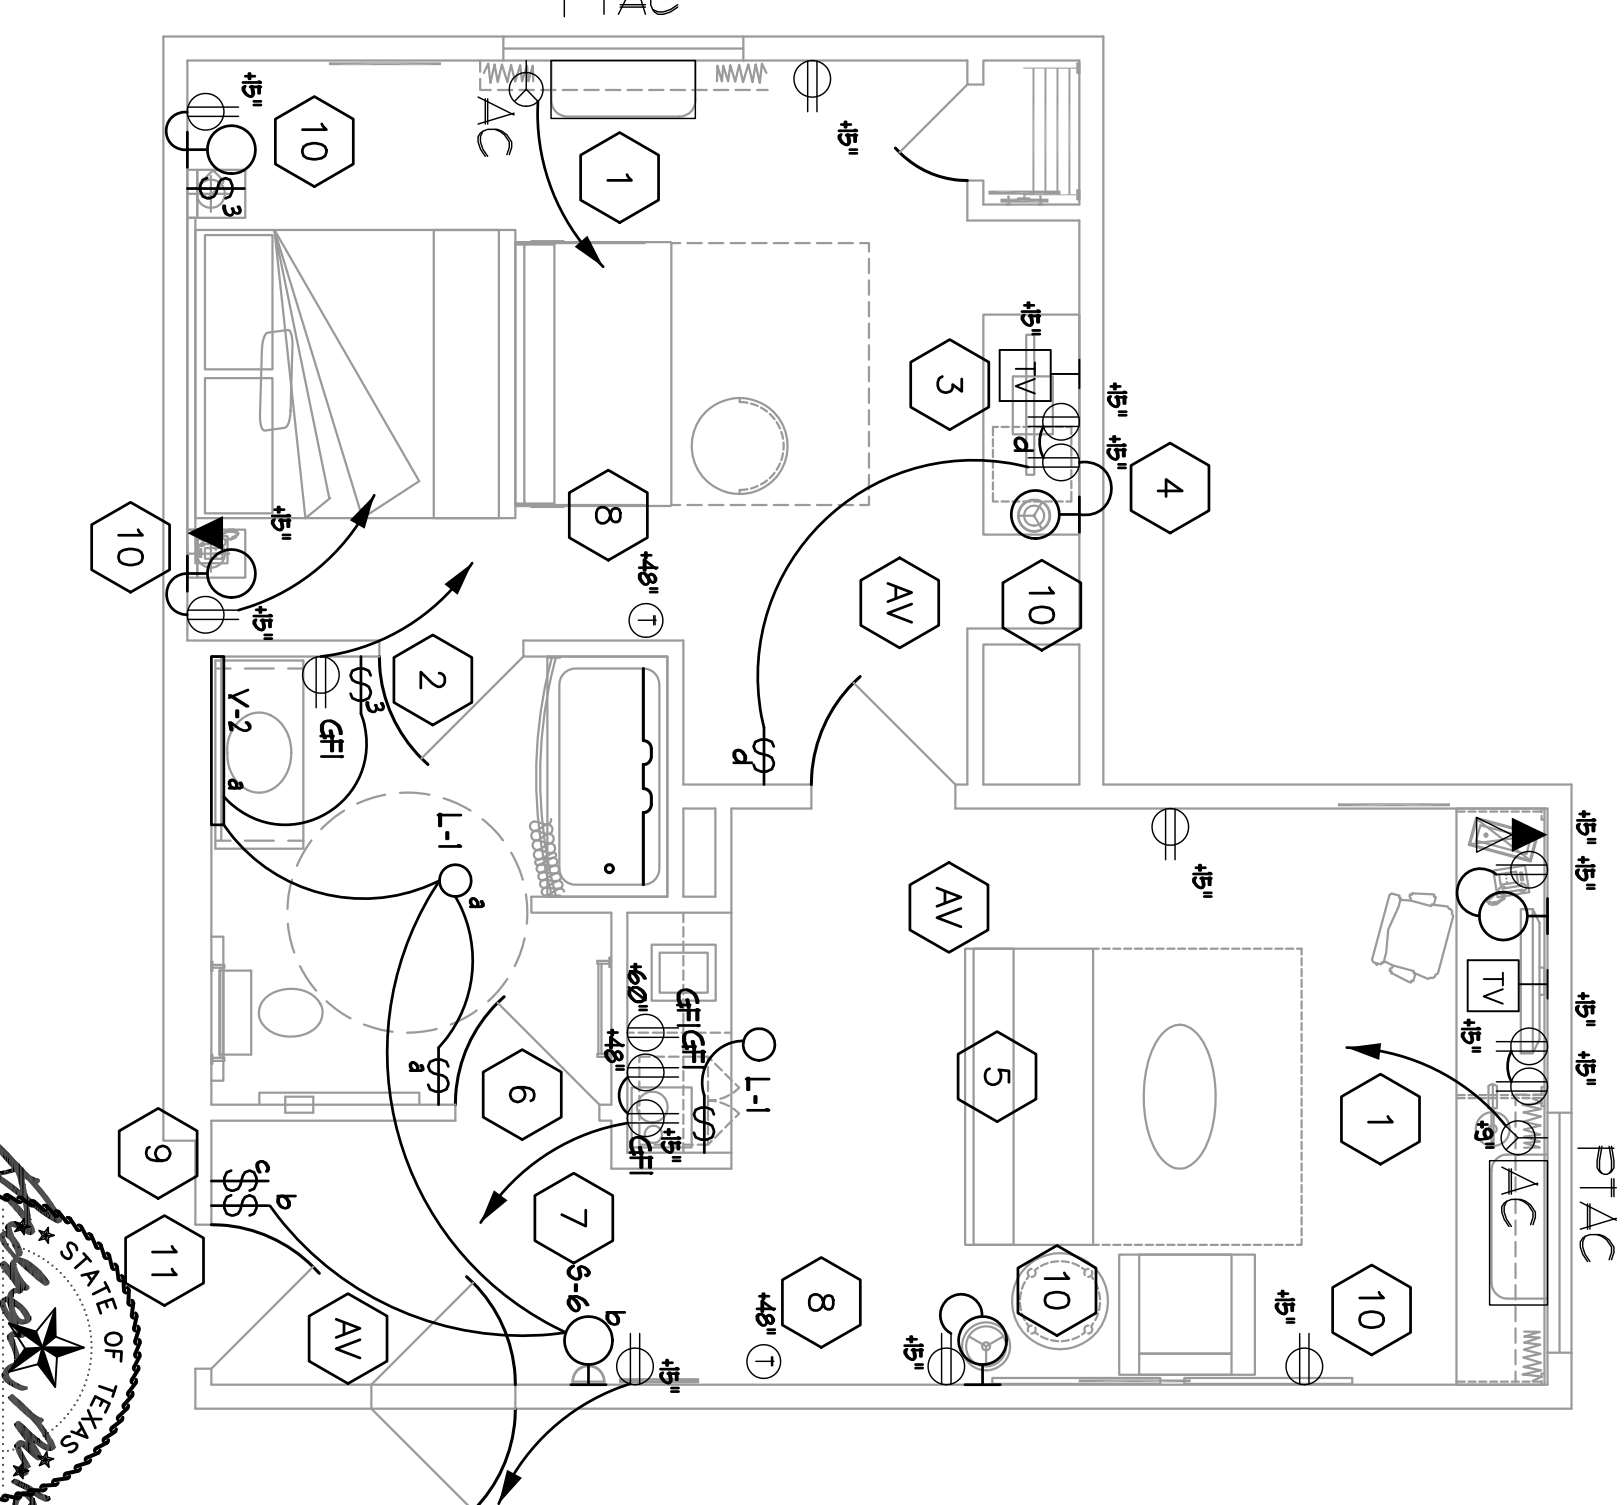

TWO ROOM SUITE ACCESS.

SCALE: 1/4" = 1'-0"


SIMILAR FOR ROOMS 601.  
CONNECT WITH NO MORE THAN 7 RECEPTACLE OUTLETS PER EACH 20A CIRCUIT.

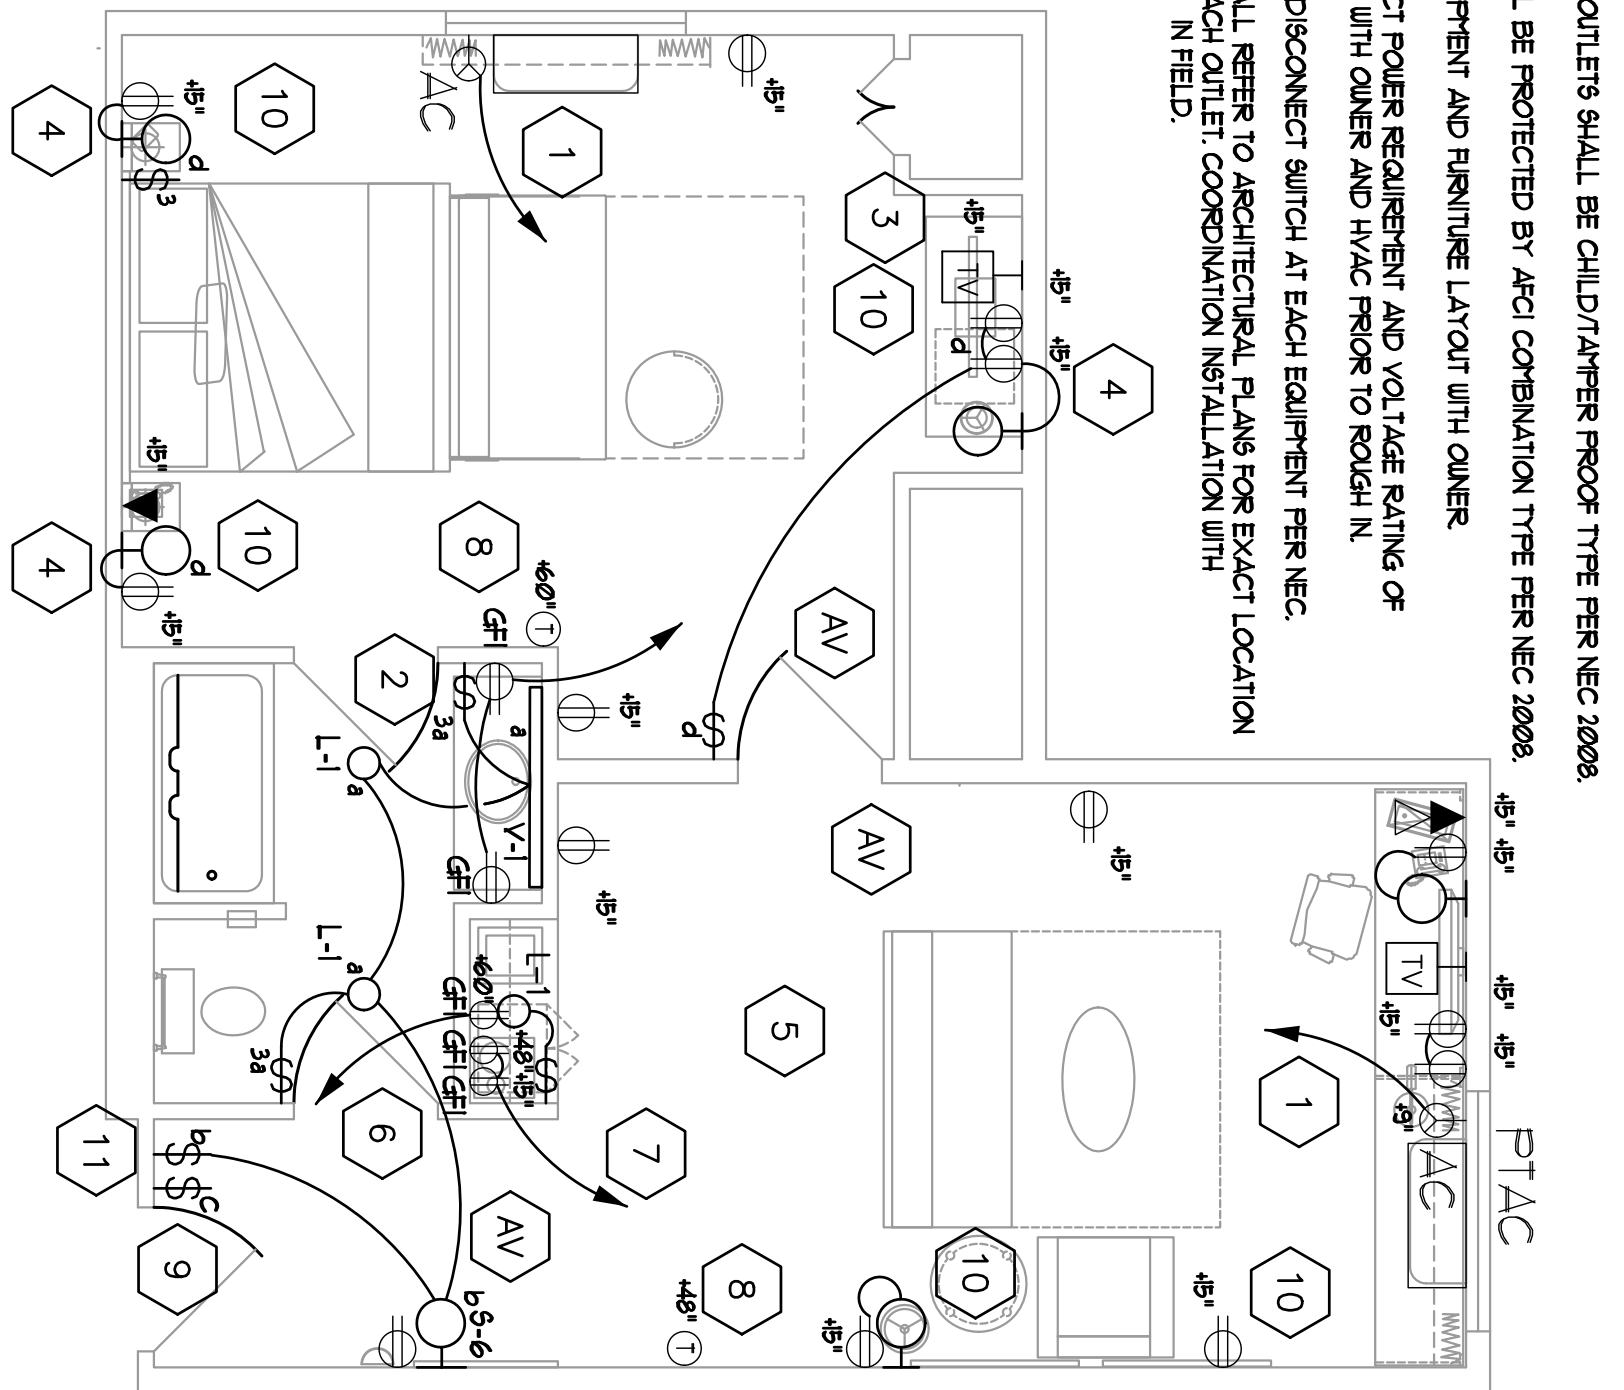

TWO ROOM SUITE

SCALE: 1/4" = 1'-0"


SIMILAR FOR ROOMS 201, 301, 401.  
CONNECT WITH NO MORE THAN 7 RECEPTACLE OUTLETS PER EACH 20A CIRCUIT.

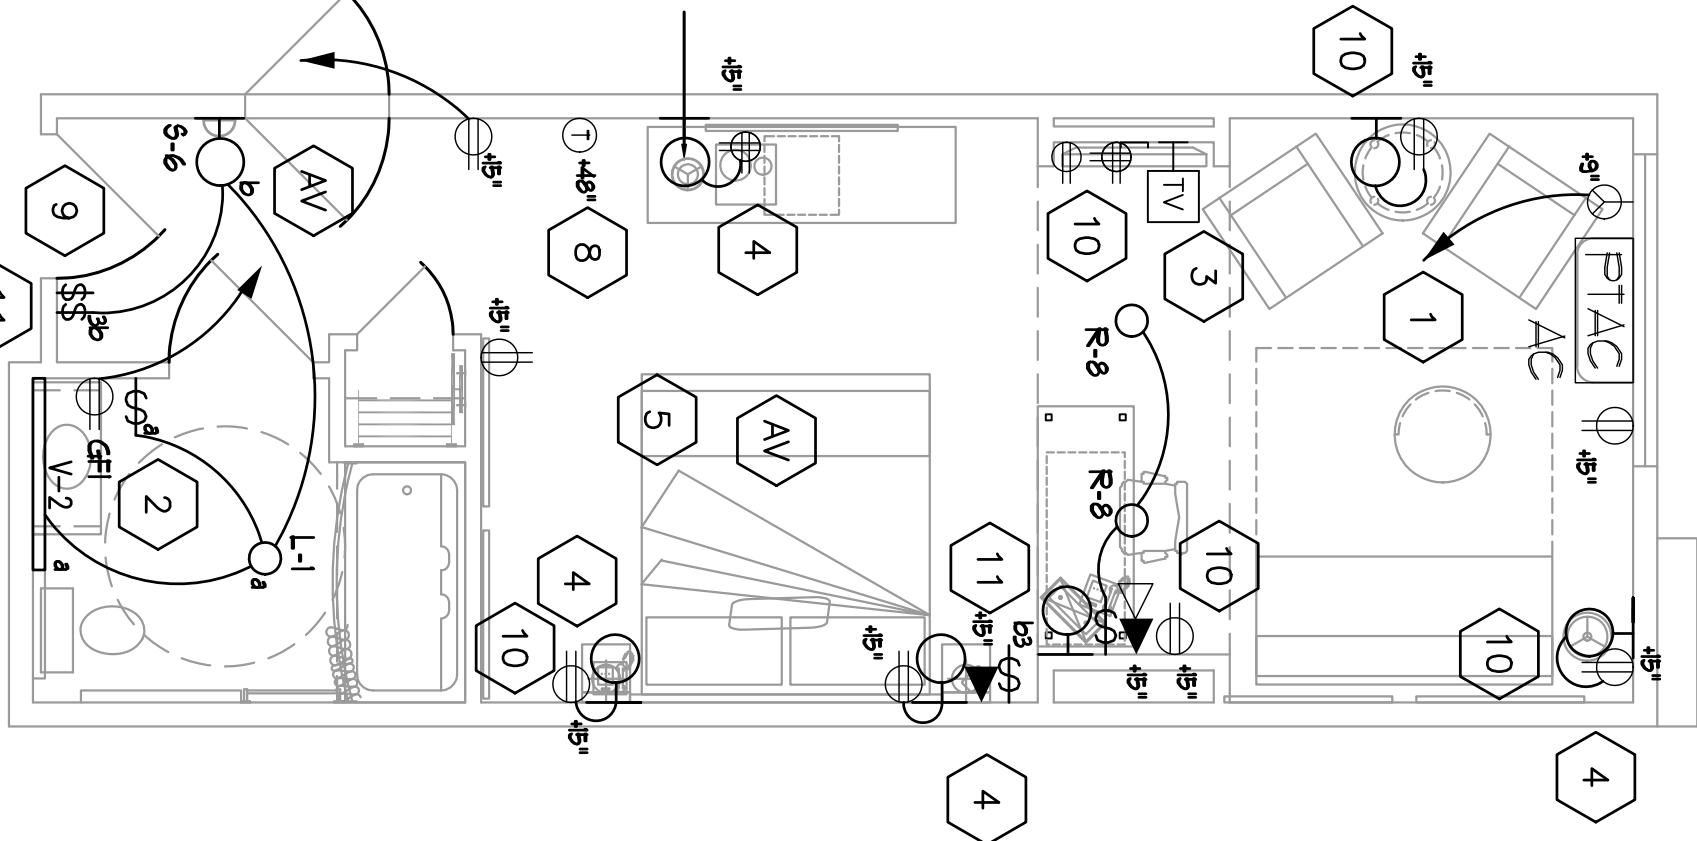

KING ROOM SUITE ACCESS.

SCALE: 1/4" = 1'-0"


SIMILAR FOR ROOMS 104, 204.  
CONNECT WITH NO MORE THAN 6 RECEPTACLE OUTLETS PER EACH 20A CIRCUIT.

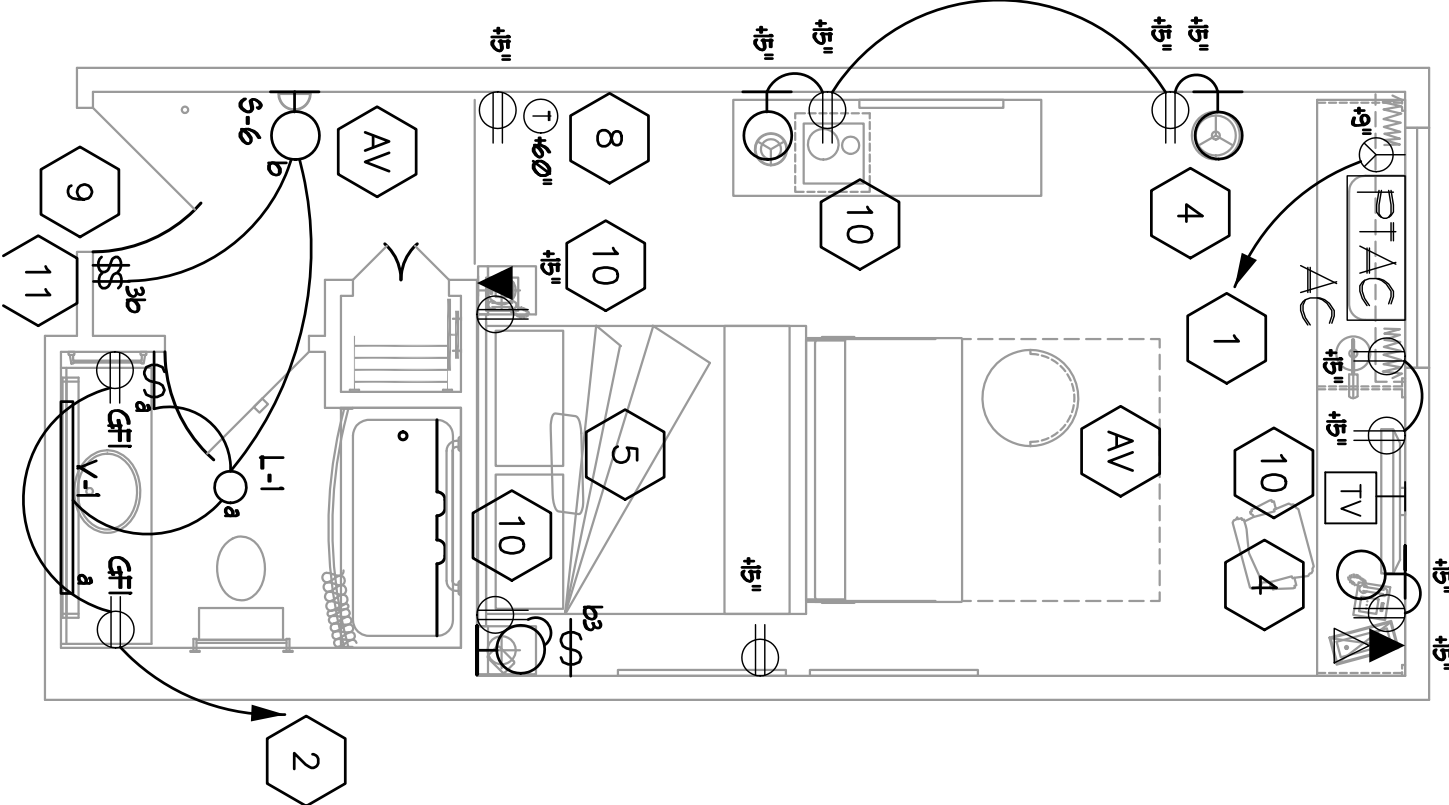

KING ROOM

SCALE: 1/4" = 1'-0"

SIMILAR FOR ROOMS 106, 108, 109, 110, 109, 111, 109, 120, 206, 201, 209, 222, 224, 226, 306, 308, 310, 312, 318, 320, 322, 324, 326, 406, 408, 410, 412, 416, 418, 420, 422, 424, 426.  
CONNECT WITH NO MORE THAN 5 RECEPTACLE OUTLETS PER EACH 20A CIRCUIT.

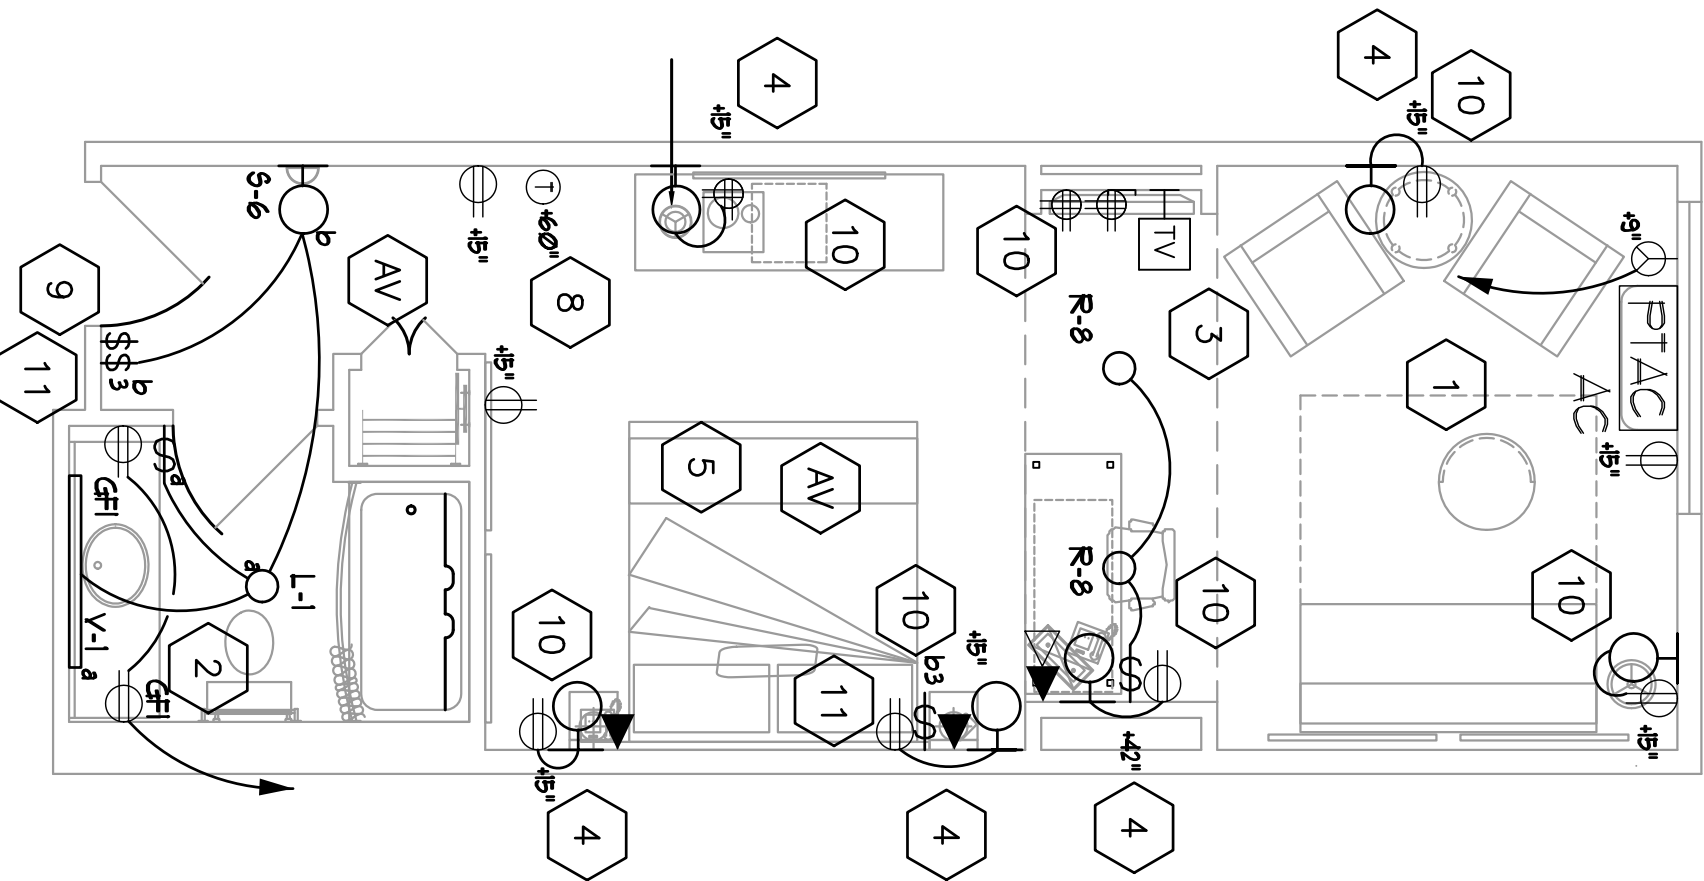

KING ROOM SUITE

SCALE: 1/4" = 1'-0"

SIMILAR FOR ROOMS 021, 201, 228, 230, 301, 304, 328, 330, 401, 404, 428, 430.  
CONNECT WITH NO MORE THAN 6 RECEPTACLE OUTLETS PER EACH 20A CIRCUIT.

- SPECIAL NOTES FOR ALL GUEST ROOMS
- ALL RECEPTACLE OUTLETS SHALL BE CHILD/ANFIER PROOF TYPE PER NEC 2008.
  - ALL CIRCUIT SHALL BE PROTECTED BY AFCI COMBINATION TYPE PER NEC 2008.
  - COORDINATE EQUIPMENT AND FURNITURE LAYOUT WITH OWNER.
  - VERIFY THE EXACT POWER REQUIREMENT AND VOLTAGE RATING OF EACH EQUIPMENT WITH OWNER AND HVAC PRIOR TO INSTALL IN.
  - PROVIDE LOCAL DISCONNECT SWITCH AT EACH EQUIPMENT PER NEC.
  - CONTRACTOR SHALL REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATION OF ALL ELECTRICAL OUTLET. COORDINATION INSTALLATION WITH FURNITURE SUPPLIER IN FIELD.

THE SEAL APPEARING ON THIS DOCUMENT WAS AUTHORIZED BY ANDREW J. MOK & REVIEWED ONLY. ALTERATION OF A SEALED DOCUMENT WITHOUT PROPER PERMISSION FROM THE ABOVE ENGINEER IS AN OFFENSE TO THE TEXAS STATE BOARD RULES.

09-1-10  
ANDREW J. MOK  
REGISTERED PROFESSIONAL ENGINEER  
STATE OF TEXAS

MOK Associates Inc. (firm #1447)  
P.O. Box 201459  
Arlington, Texas 76006  
Ph. 817.522.3925  
E-mail address: amok@mok-associates.com